




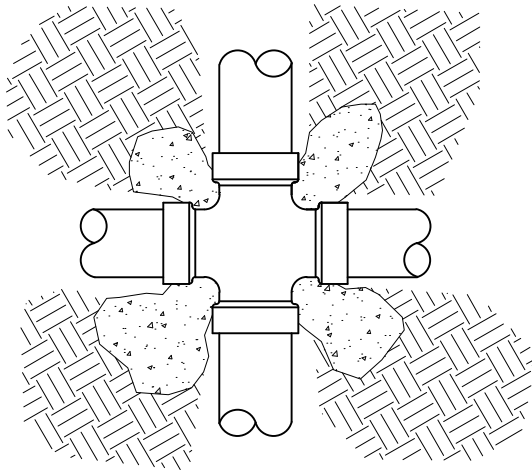


CROSS

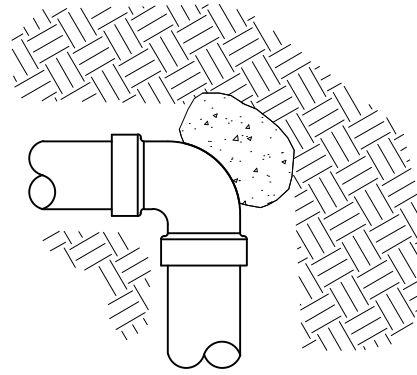


ELL

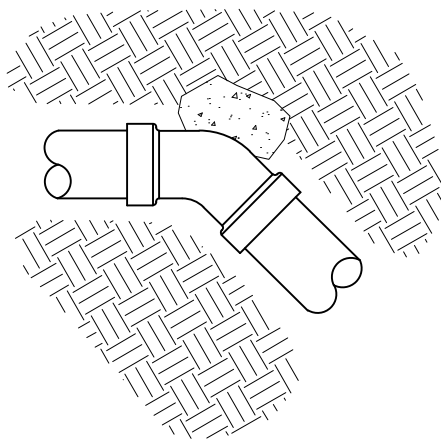

45° ELL

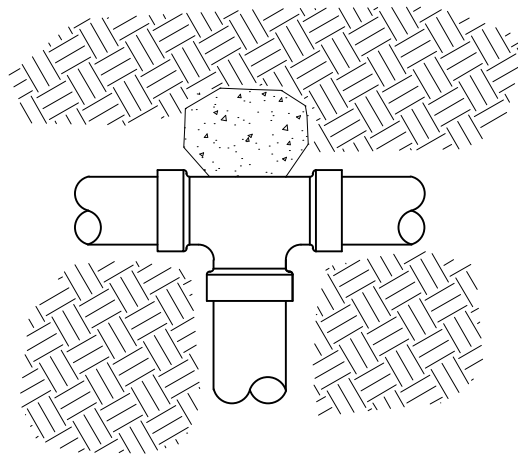

TEE

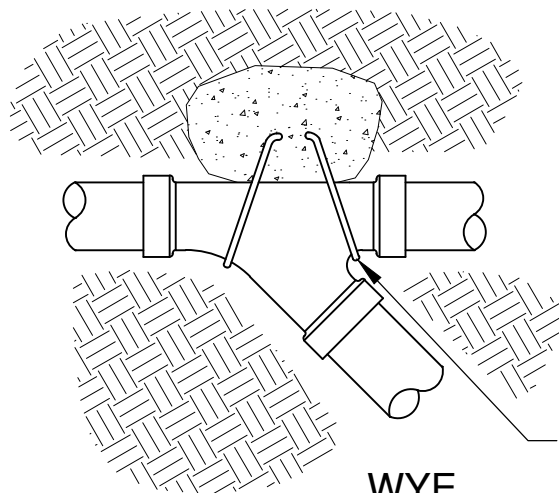

REBAR LOOP TIE

WYE

NOTES:

1. SUPPLY LINES 3" IN DIAMETER AND LARGER SHALL RECEIVE THRUST BLOCKS
2. USE A MINIMUM 1 CU FT OF CONCRETE IN EACH THRUST BLOCK POUR

DRAWN	LJC
DIV	LNDSCP
REV	DATE



CITY OF BEND

CITY OF BEND

STANDARD DRAWING

710 NW WALL ST., BEND, OREGON 97701

IRRIGATION FITTINGS

SCALE NTS

DATE 12/1/17

APPR

STD DWG L-5