


1 30" LINEAR LENGTH OF WIRE, COILED
 2 WATER PROOF CONNECTION (1 OF 2)
 3 ID TAG
 4 VALVE BOX WITH COVER: AMETEK STANDARD OR EQUAL
 5 FINISH GRADE/TOP OF MULCH ALLOW 2" DEPTH MIN FOR BARK IF LOCATED IN SHRUB BED
 6 REMOTE CONTROL VALVE: AS SPECIFIED ON DRAWING
 7 PVC SCHEDULE 40 PIPE
 8 PVC SADDLE FEMALE THREAD
 9 TREATED WOOD OR BRICK SUPPORT (LENGTH AS REQ'D.)
 10 CONTROL WIRING 24 VAC
 11 PVC MAINLINE PIPE
 12 SCH 80 MALE ADAPTER
 13 PVC ELECTRICAL CONDUIT SIZE AS SHOWN ON DRAWINGS
 14 PVC SCH 40
 15 GRAVEL BED AT BOTTOM OF BOX 6" MIN DEPTH



DRAWN	LJC
DIV	LNDSCP
REV	DATE
1	12/10/21

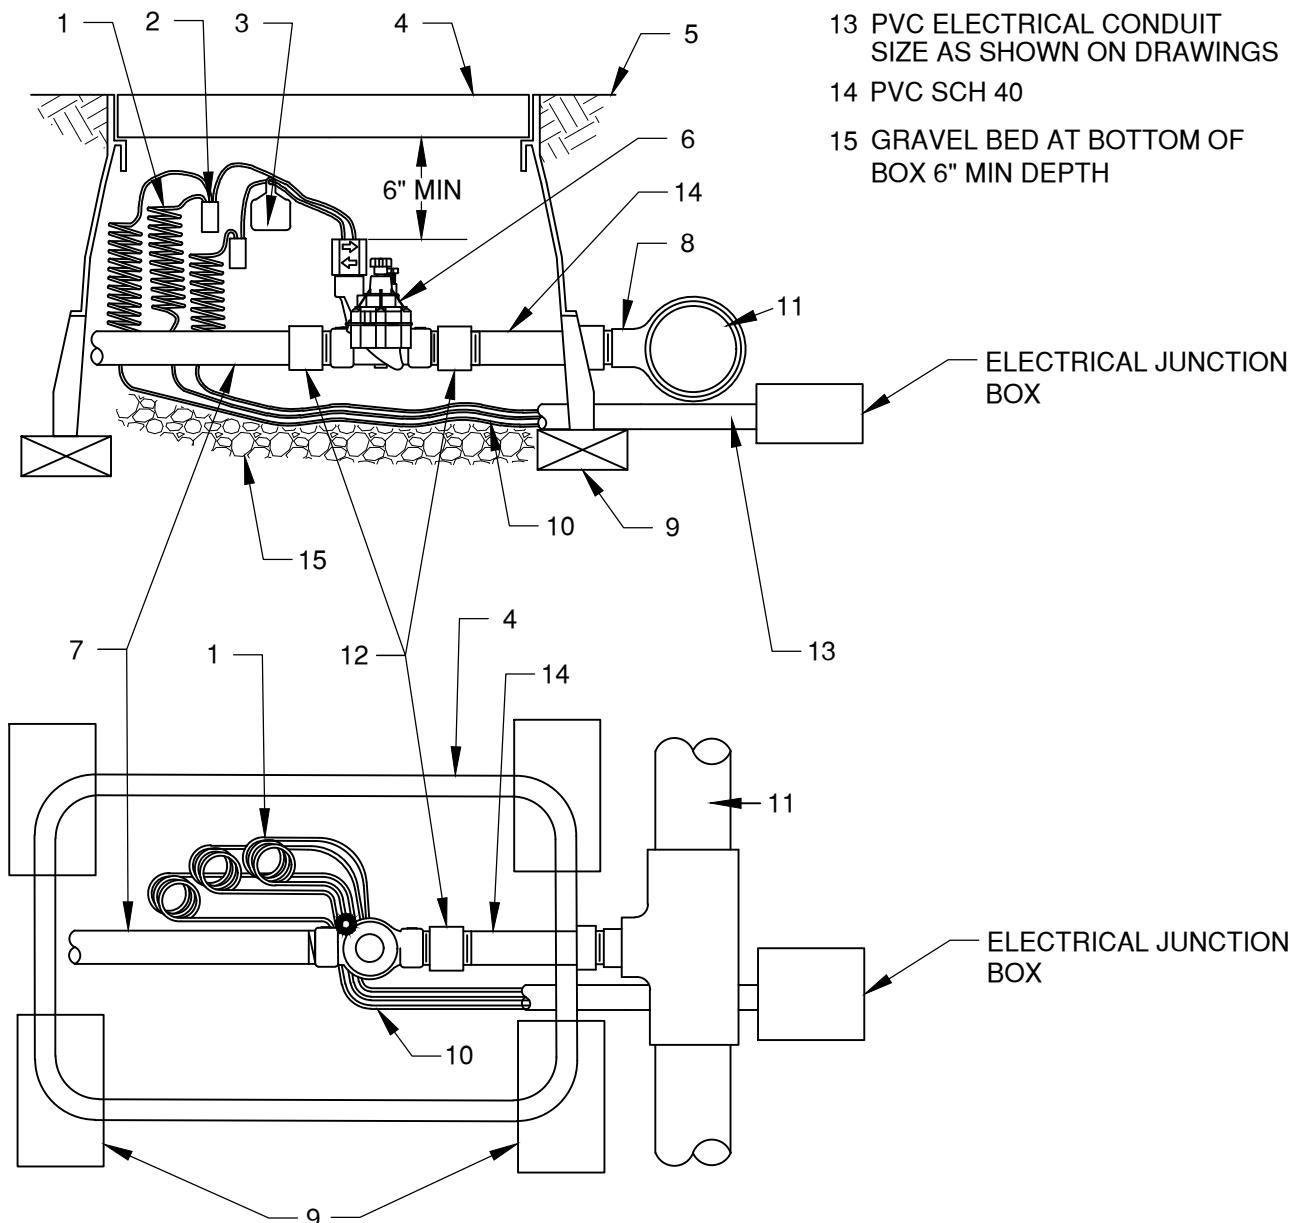

CITY OF BEND

CITY OF BEND

STANDARD DRAWING

710 NW WALL ST., BEND, OREGON 97701

IRRIGATION REMOTE CONTROL VALVE

SCALE NTS

DATE 12/1/17

APPR

STD DWG L-6