


WYE SERVICE CONNECTION
(FOR USE ON MAINS 12" AND SMALLER)

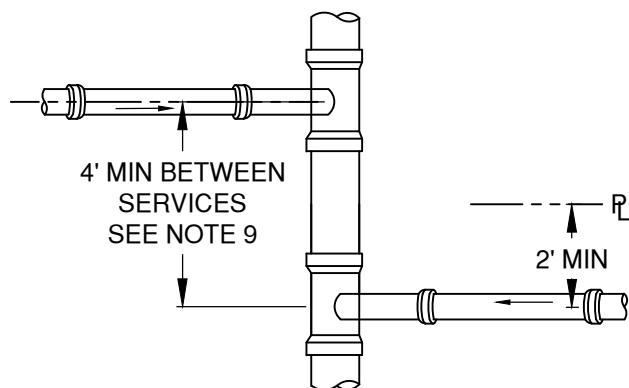

TEE SERVICE CONNECTION
(FOR USE ON MAINS LARGER THAN 12"
OR ON EXISTING MAINS FOR INFILL
SERVICE CONNECTIONS)

NOTES:

1. ALL TRENCHES TO CONFORM TO STD DWG R-10
2. SERVICES OFF NEW MAINS SHALL BE WYE OR TEE CONNECTIONS. SEE STD DWG S-2B FOR SERVICES OFF EXISTING MAINS
3. TRACER WIRE REQUIRED ON ALL SEWER / STORM SERVICES. MARKING TAPE SHALL BE INSTALLED AS SHOWN.
4. SEWER / STORM CONNECTION FROM THE PROPERTY LINE/ROW LINE TO THE CLEAN OUT NEAR THE BUILDING FOUNDATION REQUIRES A PLUMBING PERMIT.
5. WHEN A SEWER SERVICE IS LOCATED ABOVE OR WITHIN 18" BELOW A WATERLINE, THE SEWER SERVICE SHALL BE CONSTRUCTED WITH A MIN. 20 LF OF AWWA C900 OR AWWA C905 PIPE CENTERED AT THE WATERLINE PER OAR 333-061-0050(9).
6. STANDARD RESIDENTIAL SEWER SERVICES ARE 4"Ø. COMMERCIAL, INDUSTRIAL SEWER SERVICES ARE 6"Ø UNLESS OTHERWISE SIZED LARGER BY THE SITE'S ENGINEER.
7. WHERE A SERVICE CROSSES A NEW CURB, STAMP THE FACE OF CURB PER STD DWG R-3.
8. GRAVITY SEWER STANDARDS APPLY TO STORM SEWER MAINS.
9. MINIMUM 3' SECTIONS OF PIPE ARE REQUIRED BETWEEN FITTINGS.
10. ALL STORM SEWER LATERALS MUST COMPLY WITH CITY SEWER STANDARDS.

DRAWN AJD	 CITY OF BEND	CITY OF BEND STANDARD DRAWING 710 NW WALL ST., BEND, OREGON 97701	SCALE NTS
DIV SANITARY			DATE 03/22/2023
REV DATE			APPR
		GRAVITY SEWER/STORM SERVICES ON NEW MAINS	STD DWG S-2A