



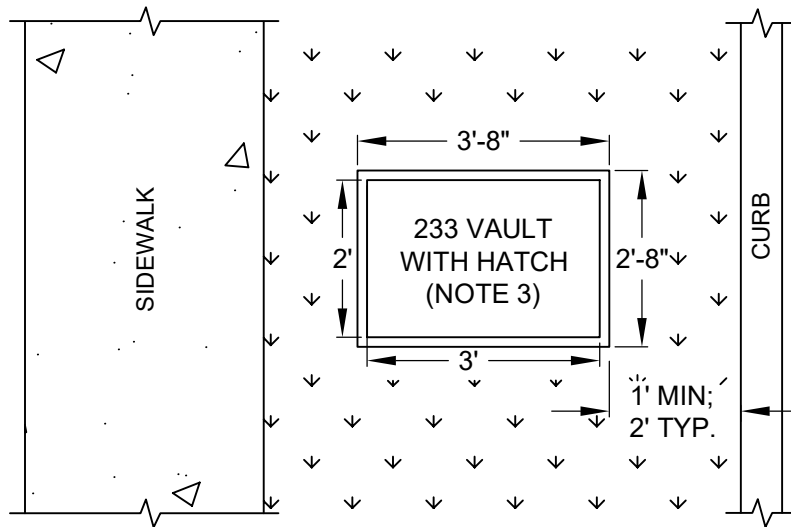

**AIR RELEASE VALVE LOCATION
PLAN VIEW**

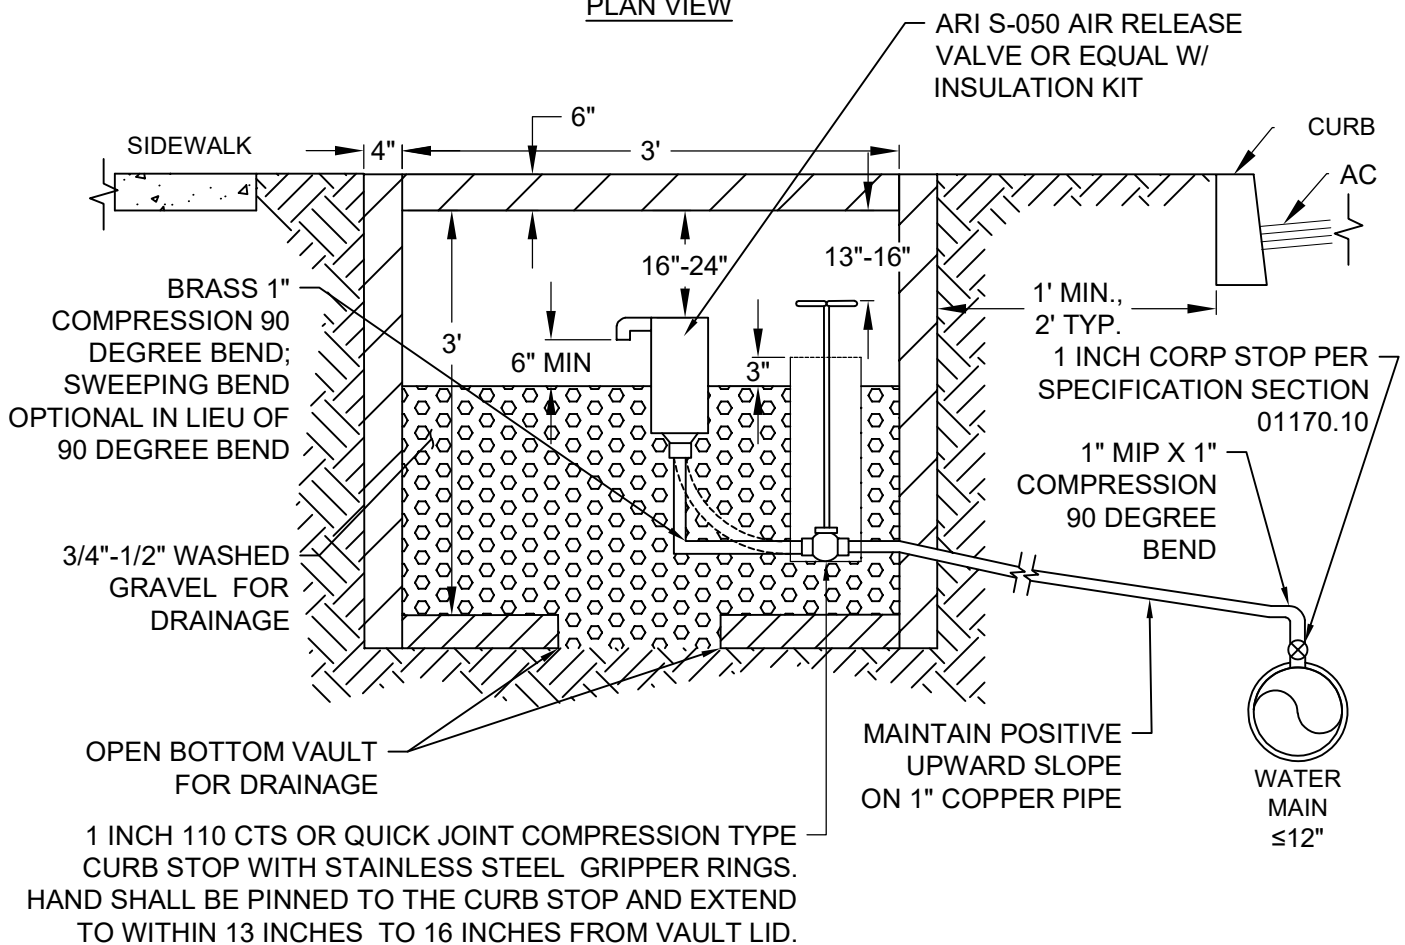

GENERAL NOTES:

1. AIR RELEASE OR COMBINATION VALVES SHALL BE INSTALL AT ALL HIGH POINTS. WHERE THE HIGH POINT IS AT THE TOP OF A LONG ASCENT (1,250 FEET+) A COMBINATION AIR/VACUUM VALVE SHALL BE INSTALLED.
2. IF 1" AIR RELEASE VALVE IS INSTALLED IN TRAFFIC AREA, INSTALL PER STD DWG W-10.
3. VAULT SHALL BE PRECAST VAULT WITH 2'X3' HATCH AND OPEN BOTTOM, OR APPROVED EQUAL.

DRAWN	AJD
DIV	WATER
REV	DATE



CITY OF BEND

CITY OF BEND

STANDARD DRAWING

710 NW WALL ST., BEND, OREGON 97701

1" STANDARD AIR RELEASE VALVE

SCALE NTS

DATE 11/01/2024

APPR

STD DWG W-10A