



DRAWING IS FOR REFERENCE ONLY

WHERE THE STRUCTURE IS PROPOSED
OUTSIDE THE RIGHT OF WAY OR
UTILITY EASEMENT

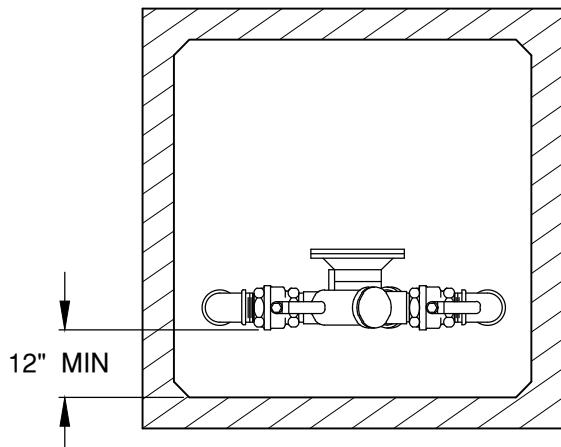

VAULT SPECIFICATIONS

WATER LINE DIAMETER	MODEL
1"	OLDCASTLE 3030-LA (OR EQUAL)
1-1/2" - 2"	OLDCASTLE 3642-PUT (OR EQUAL)

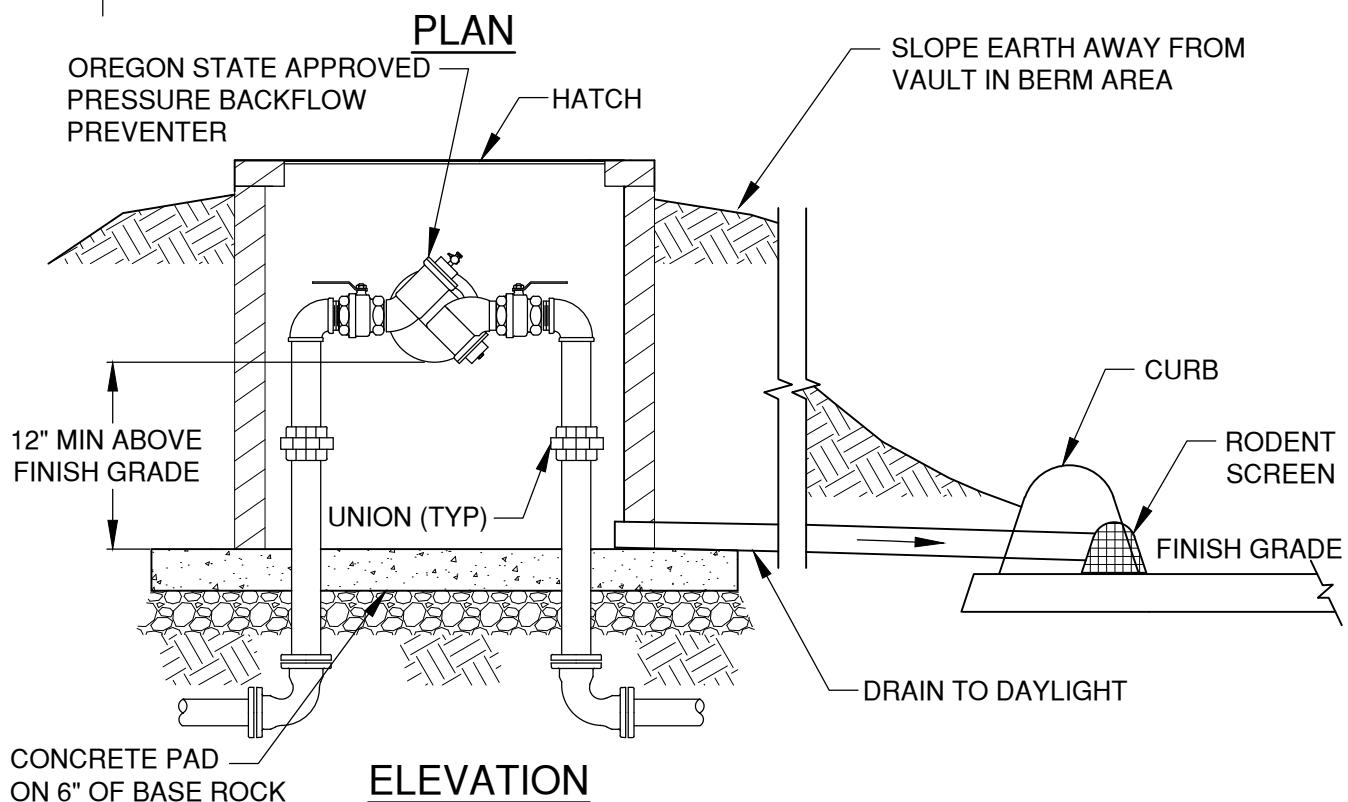

NOTES:

1. THIS DRAWING IS FOR REFERENCE ONLY. INSTALL PER PLUMBING CODE AND BUILDING DEPARTMENT REQUIREMENTS.
2. REDUCED PRESSURE BACKFLOW ASSEMBLY TO BE LOCATED DIRECTLY DOWN STREAM OF WATER METER
3. BRASS, STAINLESS, OR PLASTIC PLUGS TO BE INSTALLED IN TEST COCKS IF BELOW GROUND INSTALLATION
4. HIGH OR LOW HAZARD CONNECTIONS SHALL BE IDENTIFIED AND VERIFIED WITH CITY CROSS CONNECTION SPECIALIST

DRAWN AJD	 CITY OF BEND	CITY OF BEND STANDARD DRAWING 710 NW WALL ST., BEND, OREGON 97701 1"-2" REDUCED PRESSURE BACKFLOW ASSEMBLY	SCALE NTS
DIV WATER			DATE 01/31/2022
REV DATE			APPR
			STD DWG W-15A