


DRAWING IS FOR REFERENCE ONLY


(SEE NOTE 3)

WHERE THE STRUCTURE IS PROPOSED
OUTSIDE THE RIGHT OF WAY OR
UTILITY EASEMENT

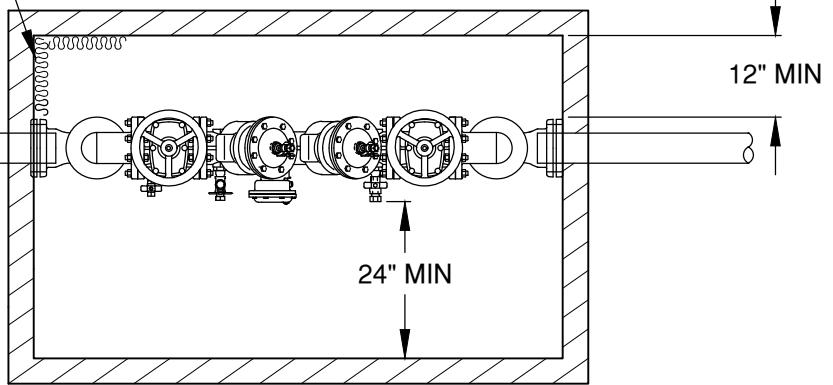

PLAN

1060 ASSE
CLASS 1;
WATTS BOX,
SAFE-T-COVER,
HOT BOX, OR
EQUAL

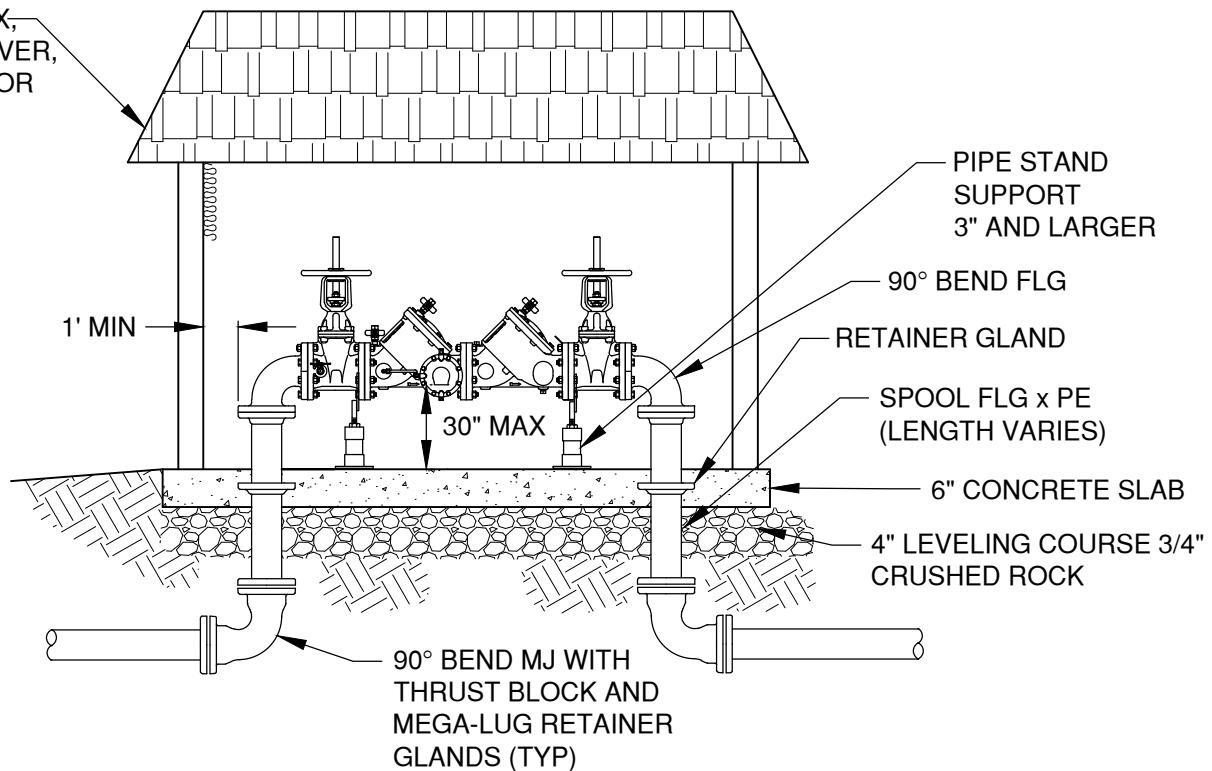

NOTES:

PROFILE

1. THIS DRAWING IS FOR REFERENCE ONLY. INSTALL PER PLUMBING CODE AND BUILDING DEPARTMENT REQUIREMENTS OR AS BY MANUFACTURER'S REQUIREMENTS.
2. REDUCED PRESSURE BACKFLOW ASSEMBLY SHALL BE INSTALLED HORIZONTALLY UNLESS APPROVED FOR OTHER ORIENTATION
3. ALL CLEARANCES APPLY TO OUTSIDE, IN-BUILDING, AND VAULT INSTALLATIONS
4. STRUCTURE TO BE INSULATED AND HAVE A HEAT SOURCE TO KEEP ENCLOSURE AT 40°F (NFPA 13-4-5.4.1.1)
5. ENCLOSURE SHALL INCLUDE A BORE SIGHTED DRAIN TO DAYLIGHT CAPABLE OF DRAINING A FULL RELIEF VALVE DISCHARGE. MAKE/MODEL/SIZE WILL DICTATE THE SIZE OF THE ENCLOSURE.
6. ALL ASSEMBLIES 2 1/2" AND LARGER SHALL BE FLANGED
7. HIGH OR LOW HAZARD CONNECTIONS SHALL BE IDENTIFIED AND VERIFIED WITH CITY CROSS CONNECTION SPECIALIST

DRAWN	AJD
DIV	WATER
REV	DATE



CITY OF BEND

CITY OF BEND

STANDARD DRAWING

710 NW WALL ST., BEND, OREGON 97701

SCALE NTS

DATE 01/31/2022

APPR

STD DWG W-15B

2 1/2" + REDUCED PRESSURE BACKFLOW ASSEMBLY