


ECLIPSE NO. 88 SAMPLING STATION WITH THREADED OUTLET NOZZLE AND BRASS INTERIOR, STAND PIPE GALVANIZED EXTERIOR OR APPROVED EQUAL

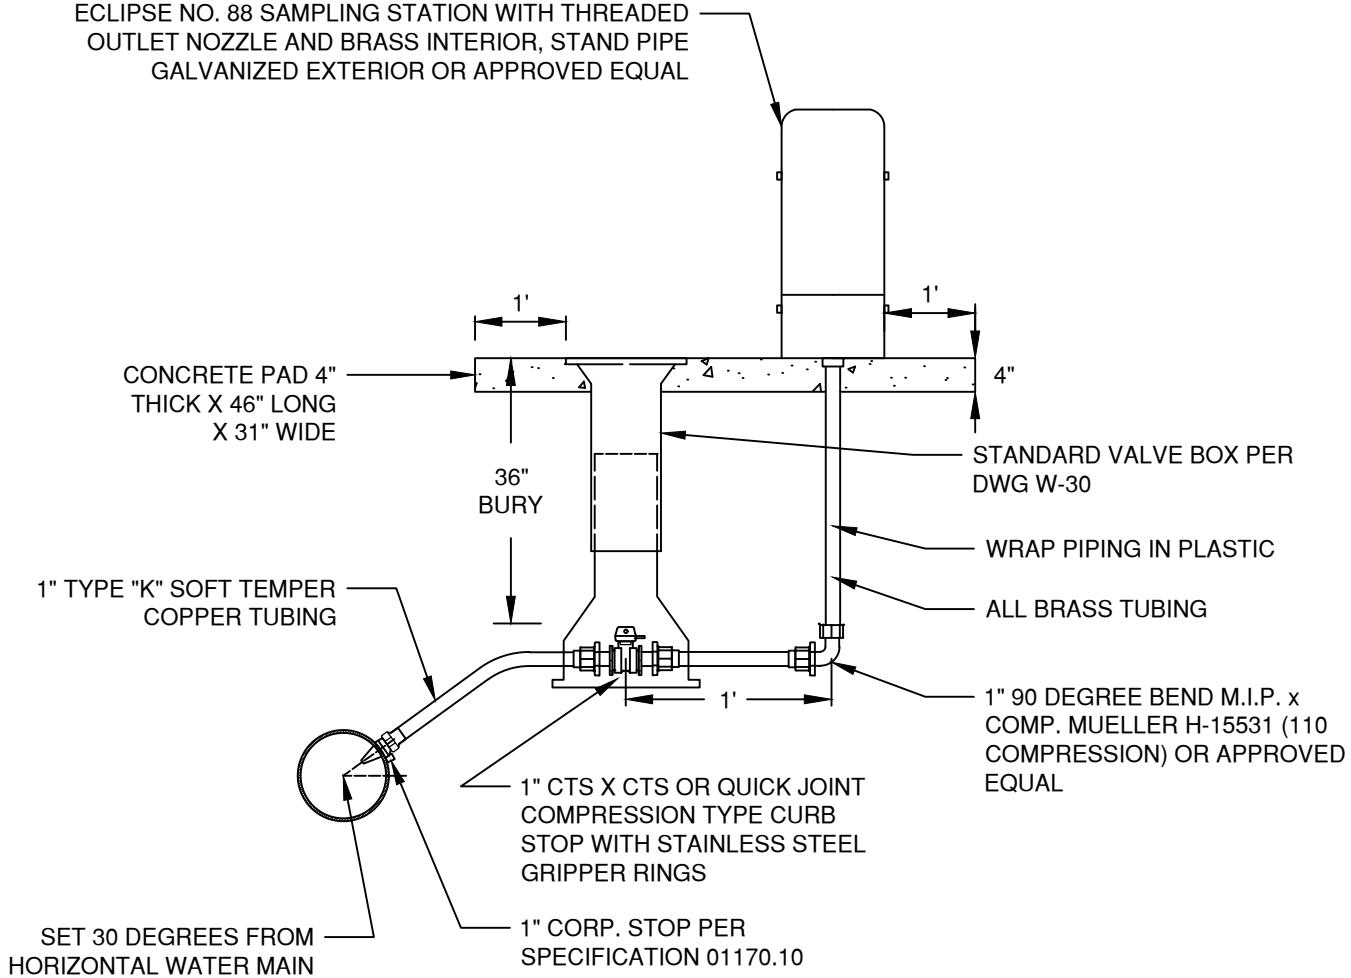

NOTES:

1. ALL PIPE AND STRUCTURES SHALL BE BACKFILLED WITH SCREENED MAX $\frac{3}{4}$ " MINUS CRUSHED ROCK. ALL COMPACTION TO COMPLY WITH SPECIFICATION SECTION 00330.43 AND 00405.46(C).
2. SET STATION AT LOT LINE UNLESS OTHERWISE SPECIFIED.
3. WHEN CROSSING, CATHODICALLY PROTECTED SYSTEM, INSTALL COPPER IN PVC SLEEVE FOR 5' EACH SIDE OF THE CROSSING.
4. WHERE NO SIDEWALK EXISTS, PLACE CONC. PAD AS SHOWN. WHERE SIDEWALKS EXIST, PLACE MIN. 12" AROUND BACK OF SAMPLE STA. AND INCORPORATE INTO NEW SIDEWALK POUR.

DRAWN	AJD	 CITY OF BEND	CITY OF BEND STANDARD DRAWING 710 NW WALL ST., BEND, OREGON 97701	SCALE NTS
DIV	WATER			DATE 11/01/2024
REV	DATE			APPR
				STD DWG W-25